

Digital
Human Machine Interface —

Pro-face

PL-X900 Series Standard Display
PL-DU6900/PL-DU7900
User Manual

Digital
Digital Electronics Corporation

Preface

Thank you for purchasing Digital's PL-DU6900/PL-DU7900 Series Standard Display (hereafter referred to as "the DU").

The DU unit uses the most up-to-date, cost-effective, high-performance architecture and is designed exclusively for use with Digital's BOX-Type Industrial Computers (hereafter referred to as "the PL").

Please read this manual carefully as it explains, step by step, how to use the DU correctly and safely.

- 1) It is forbidden to copy the contents of this manual, in whole or in part, except for the user's personal use, without the express permission of the Digital Electronics Corporation of Japan.
- 2) The information provided in this manual is subject to change without notice.
- 3) This manual has been written with care and attention to detail; however, should you find any errors or omissions, please contact Digital Electronics and inform them of your findings.
- 4) Please be aware that Digital Electronics Corporation shall not be held liable by the user for any damages, losses, or third party claims arising from the uses of this product.

All Company/Manufacturer names used in this manual are the registered trademarks of those companies.

© Copyright 2000, Digital Electronics Corporation

Essential Safety Precautions

This manual includes procedures that must be followed to operate the DU correctly and safely. Be sure to read this manual and any related materials thoroughly to understand the correct operation and functions of this unit.

Icon Meaning

Throughout this manual, the following icons are provided next to operations requiring special attention to allow you to use the DU safely. The operations described with these icons contain essential safety information. The following is an example of these icons and their meanings:



Indicates situations where severe bodily injury, death or major equipment damage can occur.



Indicates situations where slight bodily injury or machine damage can occur.

WARNINGS

System Design

- **Before connecting the DU's power cord terminals to its terminal block, be sure the power cord is disconnected from the power supply.**
- **Do not use power that is beyond the DU's specified voltage range. It may cause a fire or electric shock.**
- **Before opening the DU unit's cover, to prevent electric shocks or burns, be sure to disconnect the DU's power cord from the power supply.**
- **Do not modify the DU unit. It may cause a fire or an electric shock.**
- **Do not use touch panel keys or switches for any life related or important disaster prevention situations. Use separate hardware switches for such keys.**
- **Do not create touch panel switches that are used to either control or to ensure the safety of equipment and personnel. Mechanical switches, such as an emergency stop switch, a deadman (two-handed) start switch, etc., must be installed and operated via a separate control system.**

- After the PL's backlight burns out, unlike the PL's "Standby Mode", the touch panel is still active. If the operator fails to notice that the backlight is burned out and touches the panel, a potentially dangerous machine mis-operation can occur.

If your PL's backlight suddenly turns OFF, use the following steps to determine if the backlight is actually burned out.

- 1) If your PL is not set to "Standby Mode" and the screen has gone blank, your backlight is burned out.
 - 2) Or, if your PL is set to Standby Mode, but touching the screen does not cause the display to reappear, your backlight is burned out.
- Do not allow water, liquids, or metal particles to enter inside the DU's chassis, since they can cause either a malfunction or an electrical shock. If, however, either of these events occurs, disconnect the DU unit's power cord immediately and contact your local DU distributor.
 - Read and understand Chapter 4 "Installation and Wiring" thoroughly before selecting an installation location for the DU.
 - Do not insert/remove an expansion board or an interface unit while the DU unit's power cord is connected to the power supply.
 - To prevent a possible explosion, do not install the DU in areas containing flammable gases.
 - The DU is not appropriate for use with aircraft control devices, aerospace equipment, central trunk data transmission (communication) devices, nuclear power control devices, or medical life support equipment, due to these devices' inherent requirements of extremely high levels of safety and reliability.
 - When using the DU with transportation vehicles (trains, cars and ships), disaster and crime prevention devices, various types of safety equipment, non life-support related medical devices, etc. redundant and/or fail-safe system designs should be used to ensure the sufficient degree of reliability and safety.



CAUTIONS

- When the surface or the frame of the display becomes dirty, soak a soft cloth in water with a neutral detergent, wring the cloth tightly, and wipe the display. Do not use paint thinner, organic solvents, or a strong acid compound to clean the unit.
- Avoid using or storing the DU in direct sunlight, or in excessively dusty, dirty or hot environments.
- Do not use the DU in areas where large, sudden temperature changes can occur thereby causing condensation to form inside the unit. This can cause the unit to malfunction.
- Avoid restricting the DU's naturally occurring ventilation, or storing or using the DU in an environment that is too hot.
- Do not store or use the DU where chemicals and acids evaporate, or where chemicals and acids are dispersed into the air.
- Do not hold the DU's display stand to carry the DU. This stand is not meant for carrying the DU and if it breaks, the unit may fall and injure you.

LCD Handling Caution

The GP's LCD contains a strong irritant. If the panel is ever cracked and the LCD's liquid contacts your skin, be sure to wash it with running water for at least 15 minutes. If any of this liquid should enter your eye, be sure to flush your eye with running water for more than 15 minutes and see a doctor as soon as possible.

General Safety Precautions

LCD Usage and Handling

- The brightness of the LCD screen will depend on the screen's current display and the LCD's contrast adjustment. Any brightness variations that result are normal for LCD displays.
- There are minute grid-points (Dark or Light points) on the LCD surface. These points are not defects and are a part of the DU panel's design.
- The displayed color will look different when viewed from an angle outside the specified view angle. This is also normal.
- When installing this unit, be sure that the screen is viewable from within the designated direction, otherwise the view angle will be effected.
- Displaying a single screen image for long periods of time can cause an afterimage to remain on the screen. To correct this, turn the unit OFF for 5 to 10 minutes, then ON again. This phenomenon is a common attribute of the LCDs, and is not a defect. To prevent this effect, you can:
 - 1) Use the Display OFF feature; if the same image is to be displayed for a long period of time.
 - 2) Change the screen display periodically to prevent the displaying of a single image for a long period of time.(For further information about LCD usage and handling, contact your local DU distributor.)

Prior to Using the DU

After connecting the DU to the PL and setting up the PL's OS, you will need to input the DU's screen settings and perform touch panel calibration.

▼Reference▲ *BOX-Type Industrial Computer PL-B900/PL-B910 Series Users Manual.*

Table of Contents

Preface	1
Essential Safety Precautions	2
General Safety Precautions	5
Prior to Using the DU	5
Table of Contents	6
PL Model Number	8
Documentation Conventions	8
Special Features	9
Package Contents	10
CE Marking Notes	11
UL/c-UL(CSA) Application Notes	11 ...

CHAPTER 1 INTRODUCTION

1.1 System Design	1-1
1.1.1 RS-422 and USB Connections	1-2
1.1.2 Connecting the Dual Displays	1-3
1.2 Accessories	1-5

CHAPTER 2 SPECIFICATIONS

2.1 General Specifications	2-1
2.1.1 Electrical	2-1
2.1.2 Environmental	2-1
2.1.3 Structural	2-2
2.2 Functional Specifications	2-3
2.2.1 Performance	2-3
2.2.2 Display	2-3
2.3 Names and Functions of DU Parts	2-4
2.4 Display Unit Dimensions	2-5
2.4.1 PL-DU6900 External Dimensions	2-5
2.4.2 PL-DU7900 External Dimensions	2-5
2.4.3 PL-DU6900 Installation Fasteners	2-6
2.4.4 PL-DU7900 Installation Fasteners	2-6

CHAPTER 3 OPTIONAL UNITS

3.1 Installation 3-1
 3.1.1 Attaching the Display Expansion Board (PL-PE200) 3-2
 3.1.2 Installing the USB Front Access Unit (PL-US200) 3-5

CHAPTER 4 INSTALLATION AND WIRING

4.1 DU Installation Cautions 4-1
 4.1.1 Temperature Related Cautions 4-1
 4.1.2 Installation Positioning Cautions 4-1
 4.1.3 Shock / Vibration Related Cautions 4-1
4.2 DU Installation 4-2
 4.2.1 Installation 4-2
4.3 Wiring Cautions 4-5
 4.3.1 Connecting to PL 4-5
 4.3.2 Connecting the Power Cord 4-5
 4.3.3 Connecting the DU's Power Supply 4-7
 4.3.4 Grounding the DU 4-8
 4.3.5 Cautions When Connecting I/O Signal Lines 4-8




CHAPTER 5 MAINTENANCE

5.1 Regular Cleaning 5-1
 5.1.1 Cleaning the Display 5-1
 5.1.2 Installation Gasket Replacement 5-1
5.2 Changing the Backlight 5-2
5.3 Periodic Check Points 5-9

INDEX

Documentation Conventions

The list below describes the documentation conventions used in this manual.

Symbol	Meaning
 <i>Important</i>	Indicates important information or procedures that <u>must</u> be followed for correct and risk-free software/device operation.
*1	Indicates useful or important supplemental information.
1) , 2)	Indicates steps in a procedure. Be sure to perform these steps in the order given.
 <i>Reference</i>	Refers to useful or important supplemental information.
 <i>Note:</i>	Provides useful or important supplemental information.
PL	Refers to all BOX-Type Industrial Computers (PL-B900 and PL-B910 Series models).
DU	Refers to all standard Displays (PL-DU6900, PL-DU7900).

PL Model Number

The meaning of the DU model number is explained below.

PL-DU * 900 - T42

A B C D E F G

Item	Code	Meaning
A	PL	PL Series Industrial Computer
B	DU	PL-X900 Series Display Unit
C	6	12.1 inch SVGA
	7	15 inch XGA
D	9	X900 Series
E	T	TFT Color LCD
F	4	CE Marked, UL/c-UL(CSA) Approved
G	2	Revision No.

Special Features

The PL-DU*900's special features are as follows.

■ PL-DU6900 - 12.1" High-Brightness Color Display and Wide View Angle

The PL-DU6900's large 12.1 inch, 800 X 600 pixel TFT LCD display offers excellent visibility and brightness.



Note:

Digital's top of the line TFT color LCD model allows you to create detailed and powerful visual images, with excellent brightness, a wide viewing angle, and a display capable of 260,000 colors.

■ PL-DU7900 - 15.0" High-Brightness Color Display and Wide View Angle

The PL-DU7900's large 15.0 inch, 1024 X 768 pixel TFT LCD display offers excellent visibility and brightness.



Note:

Digital's top of the line TFT color LCD model allows you to create detailed and powerful visual images, with excellent brightness, a wide viewing angle, and a display capable of 260,000 colors.

■ Installation Options

The PL's separately designed main unit and display offer you an expanded range of usage options for all your applications.

■ Easy Front Panel Installation

The PL is designed to be installed easily into the front of any panel or device. It is also rugged enough for use in harsh, industrial environments, such as those found in the factory automation industries and boasts an IP65f rating.

Reference Refer to this chapter's "What is IP65f?"

■ High Resolution, Resistive Film Touch Panel

Standard equipment with the PL is a high resolution 1024 X 1024 touch panel. Also, the mouse emulation utility provides mouse-like functionality and pointer control.

■ Dual Display Feature (Available for use with PL-B910 Series)

You can connect 2 (two) DUs to a single PL unit using the Display Expansion Board.

■ Dual Touch Panel Feature (Available for use with PL-B910 Series)

The DU's Dual Display feature includes a Touch Panel input interlock feature to prevent accidental operation interruption or mis-operation. This program also eliminates the need for complicated settings.


■ USB Interface Feature (Available for use with PL-B910 Series)

The DU is equipped with a USB interface which allows you to connect the DU with any other USB equipped units (USB I/F Series A).


Package Contents

The DU's packing box contains the items listed below. Please check to confirm that all items shown below have been included.


DU Unit (1)
PL-DU6900-T42
PL-DU7900-T42

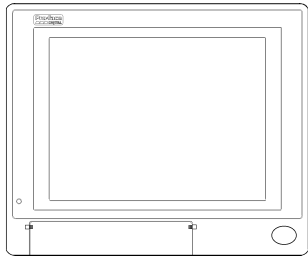

Power Cord (1)
(for AC100V/AC115V)

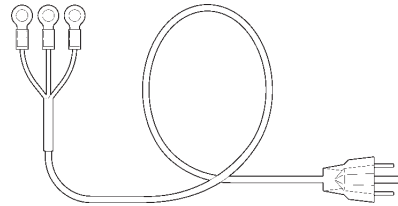


Installation Fasteners
(PL-DU6900 8/set)
(PL-DU7900 12/set)




This power cord is designed only for AC100V/AC115V use. Be sure to use a different cable when using other than AC100V/AC115V power.

**PL-X900 SERIES
STANDARD DISPLAY
PL-DU6900/PL-DU7900
USER MANUAL :**
English (1)
(This manual)



**PL-X900 SERIES
STANDARD DISPLAY
PL-DU6900/PL-DU7900
USER MANUAL :**
Japanese (1)



UL/c-UL(CSA) Application Notes

The PL-DU*900-T4* is a UL/c-UL(CSA)1950 recognized product. (UL File No. E171486). Machinery which has a DU installed in it requires UL/c-UL inspection for the combination of this unit and the machinery.

This unit conforms as a component to the following standards:

UL 1950, Third Edition, dated 1998 March 1st.

(Standard for Safety of Information Technology Equipment, including Electrical Business Equipment)

CAN/C22.2 No.950-M95

(Standard for Safety of Information Technology Equipment, including Electrical Business Equipment)

PL-DU6900-T4* (UL Registration Model: 2780053-04)

PL-DU7900-T4* (UL Registration Model: 2780053-03)

- The DU must be used as a built-in component of an end-use product.
- Use the DU indoors only.
- When connecting the DU's power cord, be sure to use a cord that is appropriate for the current and voltage used (0.75mm² or larger).
- When installing the DU to a metal panel or cabinet, be sure to design the DU's power cut-off switch as a separate device that is within easy reach by the unit's operator.
- There is a danger of explosion if the DU's backup battery is incorrectly replaced. Replace only with same or equivalent type recommended by the manufacturer. Dispose of used batteries according to the manufacturer's instructions.
- Be sure the unit the DU is built into uses a UL1950 approved structure.

CE Marking Notes

The PL-DU*900-T4* is a CE marked product that conforms to EMC directives.

This unit conforms as a component to the following standards:

Safety	EN60950
EMI <EN50081-2>	EN55011, Class A
EMS <EN50082-2>	EN61000-4-2, EN61000-4-3, EN61000-4-4, EN61000-4-6, EN61000-4-8, ENV50204

The DU unit may fail to meet the above standards if the following conditions are not maintained.

- The DU must be used as a built-in component of an end-use product.
- Use the DU indoors only.


Preface

- When connecting the DU's power cord, be sure to use a cord that is appropriate for the current and voltage used (0.75mm² or larger).
- When installing the DU to a metal panel or cabinet, be sure to design the DU's power cut-off switch as a separate device that is within easy reach by the unit's operator.
- There is a danger of explosion if the DU's backup battery is incorrectly replaced. Replace only with same or equivalent type recommended by the manufacturer. Dispose of used batteries according to the manufacturer's instructions.
- Be sure the unit the DU is built into uses an EN60950 approved structure.

Chapter 1 Introduction

1. System Design
2. Accessories

1.1 System Design

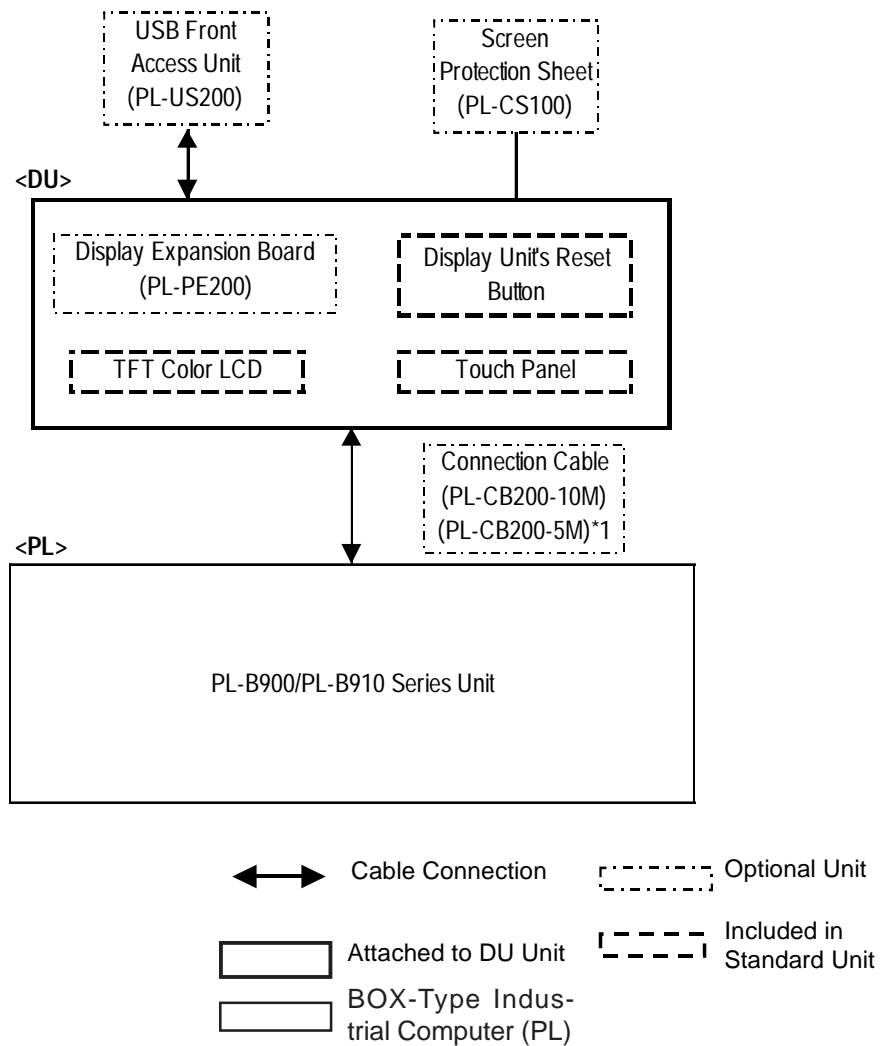

*1 When connecting the Touch Panel using aUSB cable, be sure to use the PL-CB200-5M.



The above System Configuration indicates only the connection between DU unit and the PL. The actual positioning of these units will differ.

Chapter 1 - Introduction

1.1.1 RS-422 and USB Connections

You can connect a touch panel using either a RS-422 or a USB cable.

The RS-422 and USB cables have limitations concerning the PL type, OS type and number of DU units.

Touch Panle Cable	PL Type	OS Type	Display Connection Type
RS-422 Cable	PL-B900 Series, PL-B910 Series	Windows [®] 95, Windows NT [®] 4.0	Single Display
USB Cable	PL-B910 Series	Windows [®] 98 Second Edition	Single Display
			Dual Display



- **When a DU is connected via a USB cable, be sure to wait 3 seconds after turning the power OFF before turning it ON again.**
- **Be sure to use only the OS types shown here with each cable. If a different type OS is used, the utility software (drivers, etc.) is not supported.**

■ Dip Switch Settings

Depending on the touch panel cable used, the DU unit's rear face dip switch settings will change. These settings must also be set on the PL unit's side face dip switches.

◆ RS-422 Cable Settings

PL Settings	SW No.	1	2	3	4
	On or OFF	ON	OFF	ON	OFF

DU Settings	SW No.	1	2	3	4	5	6	7	8
	On or OFF	ON	OFF	ON	OFF	OFF	OFF	OFF	ON

◆ USB Cable Settings

PL Settings	SW No.	1	2	3	4
	On or OFF	ON	OFF	ON	OFF

DU Settings	SW No.	1	2	3	4	5	6	7	8
	On or OFF	OFF	ON	OFF	ON	Station Number			OFF

For Station Number settings, Dip SW No.s 0 to 7 can be used. The combination of Dip SW No.s 5 to 7 determines the Station Number. The following list shows dip switch combinations and each combination's allocated station number.

Station Number	SW No.		
	5	6	7
0	ON	ON	ON
1	OFF	ON	ON
2	ON	OFF	ON
3	OFF	OFF	ON
4	ON	ON	OFF
5	OFF	ON	OFF
6	ON	OFF	OFF
7	OFF	OFF	OFF

1.1.2 Connecting the Dual Displays

When a USB cable is used, up to 2 DU units can be connected to a single PL unit. Connecting two displays requires two of the optional display cables (PL-CB200-5M) and one Display Expansion Board (PL-PE200). Use the following explanations when connecting the DUs and the Display Expansion Board.

Reference Chapter 3.1.1 Attaching the Display Expansion Board (PL-PE200)


When connecting an RS-422 Cable, only one display can be attached to one PL unit.



Note: There are two types of installation methods to use; the Star Method or the Daisy Chain Method.


■ Star Method

With the Star Method, the Display Expansion Board is installed in the PL and both display cables are connected to the PL.

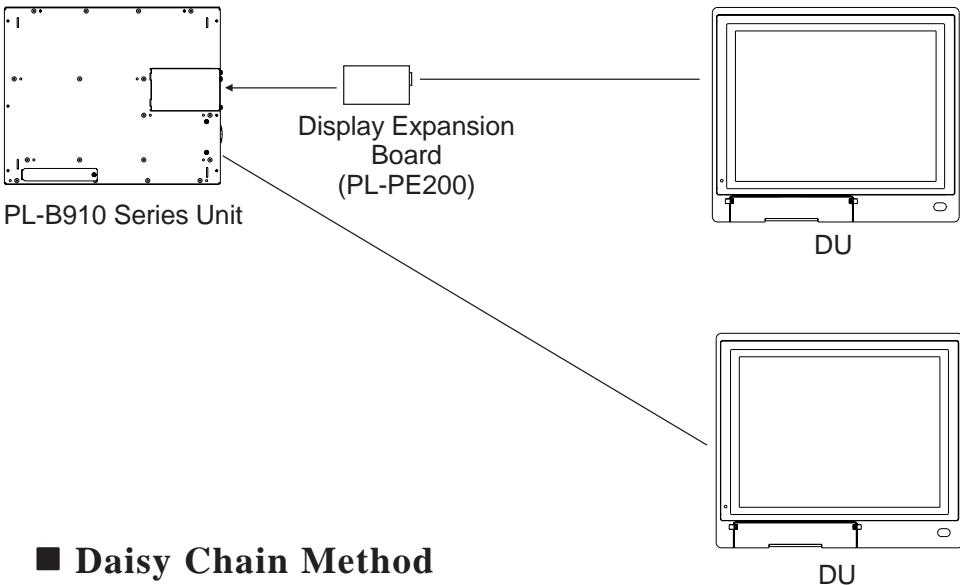

■ Daisy Chain Method

With this method, the Display Expansion Unit is installed in the first DU unit, and the 2nd DU unit is connected to the first DU unit.

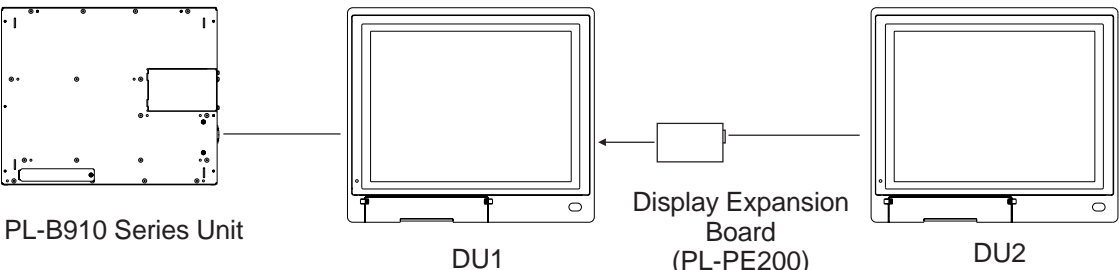

Note: The above explanations show the patterns of the PL and DU units connections. They will differ from physical PL and DU units placements.

Chapter 1 - Introduction

When attaching the Dual Displays, be sure of the following points.

- The PL unit is a PL-B910 series unit (PL-B910 or PL-B911).
- The Touch Panel connection cable should be a USB cable.
- The operating system is Windows 98 Second Edition.
- Set the PL and DU's dip switch to the USB Cable Settings. For information about PL and DU unit dip switch settings,

▼Reference▲ *1.1.1 RS-422 and USB Connections ■ Dip Switch Settings*

- The DU units used are the same model. (A PL-DU6900-T42 cannot be used with a PL-DU7900-T42 unit.)
- Be sure each DU unit's station number is unique.

▼Reference▲ *1.1.1 RS-422 and USB Connections ■ Dip Switch Settings*

- Be sure cable used to connect the displays the PL-CB200-5M.



- ***Do not connect more than 2 DU units to a single PL, since doing so may cause a malfunction.***
- ***When using Dual Displays, be sure to install the PL's interlock program to prevent interlock feature conflicts and PL unit malfunctions.***

▼Reference▲ *BOX-Type Industrial Computer PL-B900/PL-B910 Series Users Manual.*

1.2 Accessories

All accessories listed below are produced by the Digital Electronics Corporation.

■ Attachment Units

Product Name	Model No.	Description
Display Expansion Board	PL-PE200	Allows you to connect 2 DUs to a PL.
USB Front Access Unit	PL-US200	Allows you to connect other USB equipped units to the DU from the front of the DU.

■ Screen Protection Items

Product Name	Model No.	Description
Screen Protection Sheet	PL-CS100	Disposable protective and dirt-resistant sheet for the DU's screen. The DU's touch panel can be used with this cover sheet attached. (5/set) <Both for PL-DU6900 and PL-DU7900>

■ Display Cables

Product Name	Model No.	Description
Display Expansion Board	PL-CB200-5M	Connects Standard Display and Main Unit. (5m)
USB Front Access Unit	PL-CB200-10M	Connects Standard Display and Main Unit. (10m) (Used only with RS-422 connection)

■ Maintenance Items

These optional items were originally included in either the DU itself or in its packing box. These items are sold separately as optional maintenance items.

Product Name	Model No.	Description
Installation Fastener	GP070-AT00-MS	Fasteners to attach the DU to a panel. Same as the fastener included in the DU's original equipment package.
Installation Gasket	PL-WS100	Provides a drip resistant seal when installing the DU. Same as the DU's original seal. <For PL-DU6900>
	PL-WS300	Provides a drip resistant seal when installing the DU. Same as the DU's original seal. <For PL-DU7900>
Replacement Backlight	GP675-BL00-MS	Spare Backlight for maintenance. (2 bulbs/set) <For PL-DU6900>
	PL7900-BL00-MS	Spare Backlight for maintenance. (2 bulbs/set) <For PL-DU7900>

Chapter 1 - Introduction

■ Commercially Available Items

The PL-B910 Series units can use USB compatible devices. However, among the commercially available USB devices, not all will be compatible with the PL unit. For a list of the USB units that can be used with your PL, please contact your local PL distributor.



Note:

When using USB type devices, be sure they are USB compatible, and be sure to read that device's installation guide prior to connecting it to the PL.



Important

When a USB high speed device (12Mbps) is used, an error will occur, and certain PL peripheral units will not operate correctly. (ex. MO drive units, PC card units, FD drive units, and others)

Chapter

2 Specifications

1. General Specifications
2. Functional Specifications
3. Names and Functions of DU Parts
4. Display Unit Dimensions

2.1 General Specifications

2.1.1 Electrical

Input Voltage	AC100V to AC240V
Rated Voltage	AC85V to AC265V
Rated Frequency	50Hz or 60Hz
Allowable Voltage Drop	1 cycle or less (Actual drop can be more than 1 second)
Power Consumption	50VA or less
Voltage Endurance	AC1500V, 20mA for 1 minute (between charging and FG terminals)
Insulation Resistance	10M Ω or higher at DC500V (between charging and FG terminals)

2.1.2 Environmental

Ambient Operating Temperature	0°C to +50°C
Storage Temperature	-10°C to +60°C
Ambient Humidity	30%RH to 85%RH (with no condensation)
Atmosphere	Free of conductive dust and corrosive gasses
Vibration Resistance	19.6m/s ² (10Hz to 25Hz in X, Y, Z directions for 30min.)
Noise Endurance (via noise simulator)	Noise Voltage: 1500Vp-p Pulse Duration: 50ns, 500ns, 1 μ s Arise Time: 1ns
Noise Immunity	2kV (complies with IEC 61000-4-4)
Electrostatic Discharge Immunity	4kV (complies with IEC 61000-4-2)

Chapter 2 - Specifications

2.1.3 Structural

	PL-DU6900	PL-DU7900
Ratings	Equivalent to IP65f ^{*1} (JEM1030) (front face only - when installed in panel) Unit Composition: Single Unit Type Installation Method: In a solid panel	
Cooling Method	Natural air circulation	
Weight	5.5 Kg (12.1lb) or less	7.0 Kg (15.4lb) or less
External Dimensions	346mm (13.62in.) <W> x 287mm (11.3in.) <H> x 63mm (2.48in.) <D> (main unit only)	374mm (14.72in.) <W> x 325mm (12.8in.) <H> x 74mm (2.91in.) <D> (main unit only)
Grounding	100Ω or less grounding resistance ^{*2}	

**1 The front face of the DU unit, installed in a solid panel, has been tested using conditions equivalent to the standards shown in the specification . Even though the DU unit's level of resistance is equivalent to these standards, oils that should have no effect on the DU can possibly harm the unit. This can occur in areas where either vaporized oils are present, or where low viscosity cutting oils are allowed to adhere to the unit for long periods of time. If the DU's front face protection sheet becomes peeled off, these conditions can lead to the ingress of oil into the DU and separate protection measures are suggested. Also, if non-approved oils are present, it may cause deformation or corrosion of the front panel's plastic cover. Therefore, prior to installing the DU be sure to confirm the type of conditions that will be present in the DU's operating environment.*

If the installation gasket is used for a long period of time, or if the unit and its gasket are removed from the panel, the original level of the protection cannot be guaranteed. To maintain the original protection level, you need to replace the installation gasket regularly.

**2 Be sure to use your country's applicable standard.*



When using the DU with an optional unit, be sure to also confirm the option unit's specifications.

2.2 Functional Specifications

2.2.1 Performance

		PL-DU6900	PL-DU7900
Graphics		SVGA (800 X 600 dots)	XGA (1024 X 768 dots)
VESA		16 colors/ 256 colors/ 32k colors/ 64k colors	
Display Unit		12.1 inch TFT SVGA	15.0 inch TFT XGA
Touch Panel I/F	Type	Resistive Film (Analog)	
	Resolution	1024 X 1024	
	Interface	COM4 (Uses Mouse Emulator) USB Interface (USB cable uses the USB interface)	
USB I/F		1ch (Only when using USB cable)	

2.2.2 Display






		PL-DU6900	PL-DU7900
Type		TFT Color LCD (12.1 inch)	TFT Color LCD (15 inch)
Density		800 X 600 pixels	1024 X 768 pixels
Dot Pitch		0.3075mm X 0.3075 mm (0.01in. X 0.01in.)	0.297mm X 0.297mm (0.01in. X 0.01in.)
Nominal Display Area		246.0mm X 184.5 mm (9.69in. X 7.26in.)	304.1mm X 228.1mm (11.97in. X 8.98in.)
Colors		260,000	
Brightness Control		Not Available	Available
Contrast Control		Not Available	
Backlight		CCFL (Replaceable)	
Backlight Lifetime (time required for brightness to fall to half its normal level)		25,000 hours at an ambient temperature of 25°C	50,000 hours at an ambient temperature of 25°C



When replacing the Backlight, contact your local distributor.

Reference [5.2 Changing the Backlight](#)

2.3 Names and Functions of DU Parts

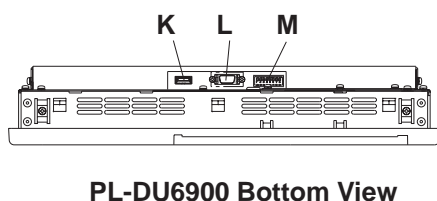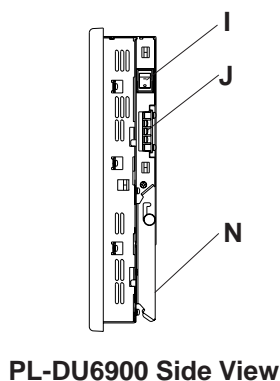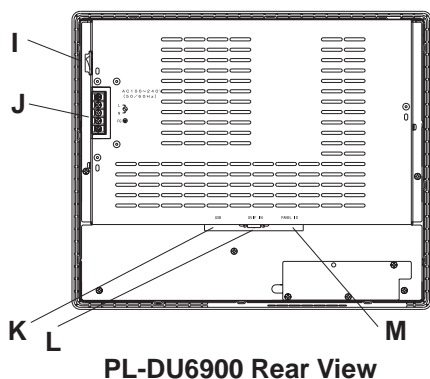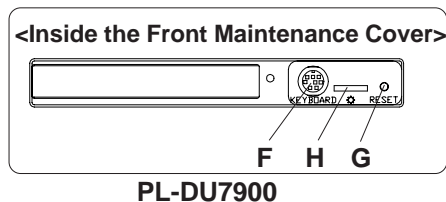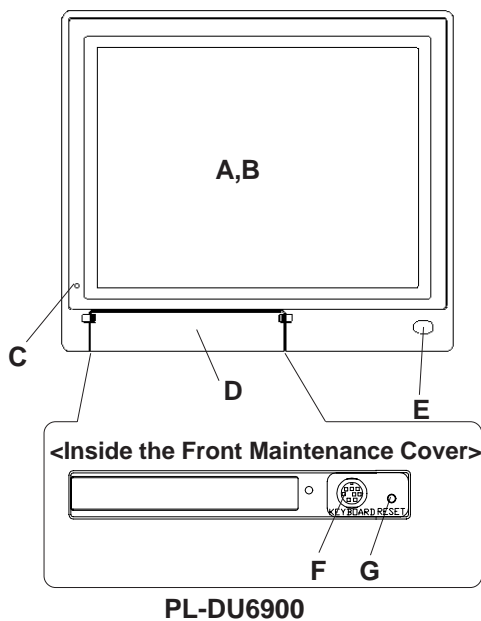

A: Display Area

Display output area.

B: Touch Panel

A high resolution analog type touch panel. Allows you to create your control systems without using a key board.

C: Status LED

The status of the lamp changes according to the alarm type detected by the RAS feature.

Reference *BOX-Type Industrial Computer PL-B900/B910 Series Users Manual*

D: Front Maintenance Cover

Open this cover when using the Hardware Reset Switch.

E: IrDA

This feature is currently unavailable.

F: (This feature is unavailable with DU)

G: Hardware Reset Switch

Resets the Display Unit only.

H: Brightness Adjustment Slide

Allows adjustment of backlight brightness. (Can be used for PL-DU7900 only.)

I: Power Switch

Turns ON/OFF the DU's power supply.

J : Power Terminals

The DU's AC100V/240V power cord terminals are connected here.

K: USB Connector

USB I/F, (USB 1.0 compatible.) Any other USB connection compatible units can be connected here.

L: PL Connector

The communication interface for PL-B900/PL-B910. To use this connector, the optional unit PL-CB200-10M is required.

M: Dip Switch

Used for setting the Touch Panel Communication method (RS-422/USB) and station (ID) numbers.

Reference **1.1.1 RS-422 and USB Connections** ■ **Dip Switch Settings**


N: Display Stand

Used to support the DU when it is removed from its installation panel.

2.4 Display Unit Dimensions


2.4.1 PL-DU6900 External Dimensions

Unit: mm <in.> (Main Unit Only)

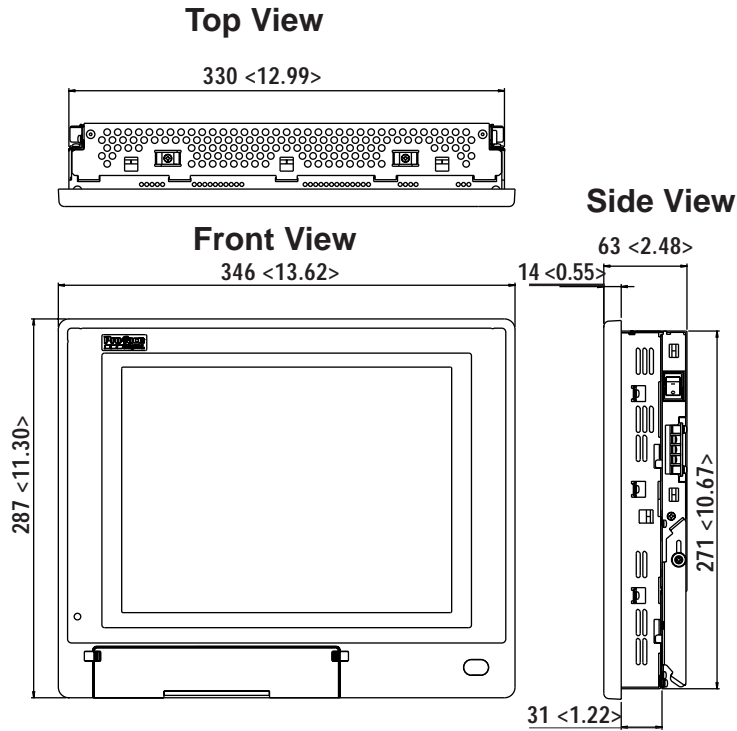


2.4.2 PL-DU7900 External Dimensions

Unit: mm <in.> (Main Unit Only)

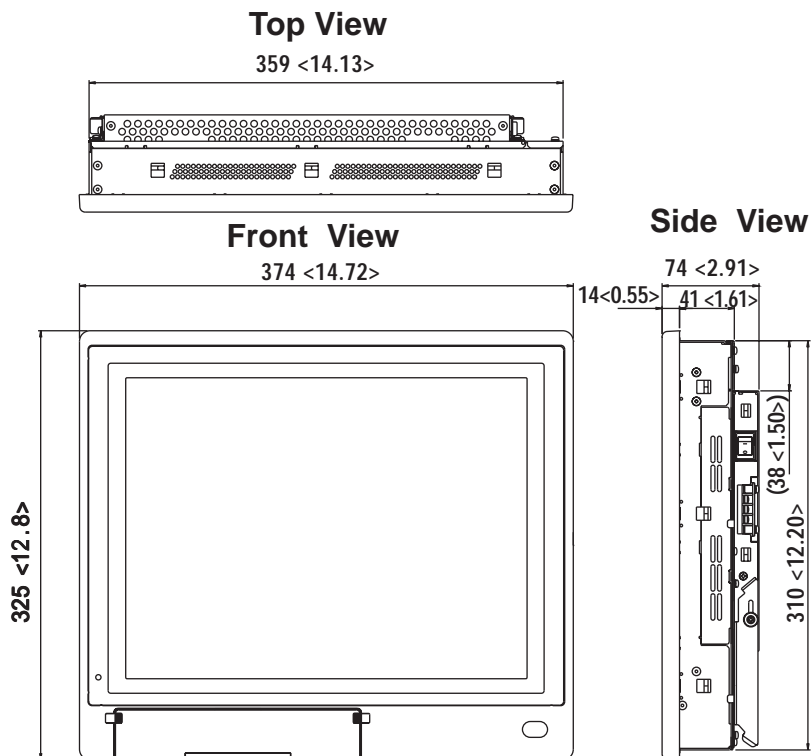

2.4.3 PL-DU6900 Installation Fasteners


Unit: mm <in.>

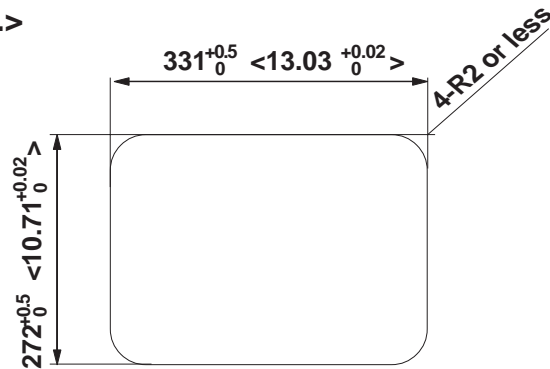

- **Be sure the thickness of the panel is from 1.6mm (0.06in.) to 10mm (0.39 in.)**
- **Depending on material used for panel surface, you may need to strengthen the panel surface. Especially, if high levels of vibration are expected and the DU's installation surface (i.e. an operation panel's door, etc.) can move (i.e. open or close) due consideration should be given to the DU's weight.**
- **To insure that the DU's water resistance is maintained, be sure to install the DU into a panel that is flat and free of scratches or dents.**
- **Be sure all installation tolerances are maintained to prevent the unit from falling out of its installation panel, or allowing water to enter inside.**

2.4.4 PL-DU7900 Installation Fasteners

Unit: mm <in.>

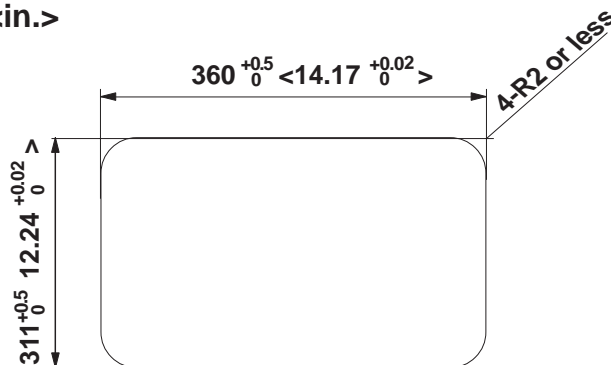

- **Be sure the thickness of the panel is from 1.6mm (0.06in.) to 10mm (0.39 in.)**
- **Depending on material used for panel surface, you may need to strengthen the panel surface. Especially, if high levels of vibration are expected and the DU's installation surface (i.e. an operation panel's door, etc.) can move (i.e. open or close) due consideration should be given to the DU's weight.**
- **To insure that the DU's water resistance is maintained, be sure to install the DU into a panel that is flat and free of scratches or dents.**
- **Be sure all installation tolerances are maintained to prevent the unit from falling out of its installation panel, or allowing water to enter inside.**

Chapter

3 Optional Units

3.1 Installation

The following explanation pages describe the installation procedures for the Display Expansion Board (PL-PE200) and the USB Front Access Unit (PL-US200).

For information about the installation of other option units, please refer to those unit's individual [Operation Instructions].



WARNINGS

To avoid electric hazards, be sure to turn the PL's power OFF before installing any optional units or expansion boards.



- ***Use a screwdriver to loosen or tighten the screws. Be careful not to over-tighten any screws, since it may damage the equipment.***
- ***Be careful when removing or inserting any screws that they do not fall inside the body of the DU.***

Chapter 3 - Optional Units

3.1.1 Attaching the Display Expansion Board (PL-PE200)

In this explanation, drawings for the PL-DU7900-T42 drawings are used.



- 1) Disconnect the DU power cord terminals from the DU's power terminal block.




Be sure to place the DU unit on a flat, level surface prior to installing the PL-PE200. This will prevent damage to the DU and the accidental cutting of any of its power cord terminals.



The PL-DU7900-T42 is equipped with a Side Cover. When installing the PL-PE200 in a PL-DU7900-T42, you need to unscrew this cover's two (2) attachment screws and remove the cover.

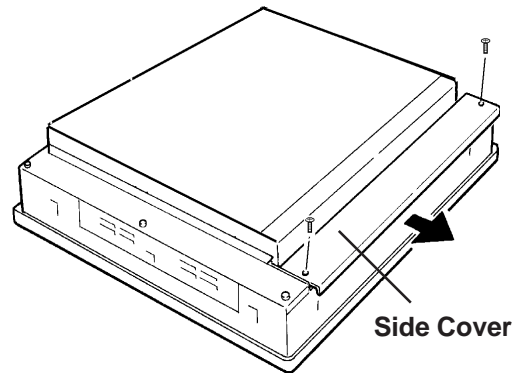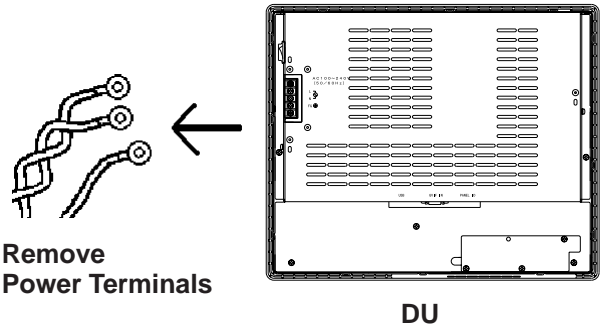


- 2) Unscrew the DU's four (4) attachment screws and slide the Rear Part upwards.

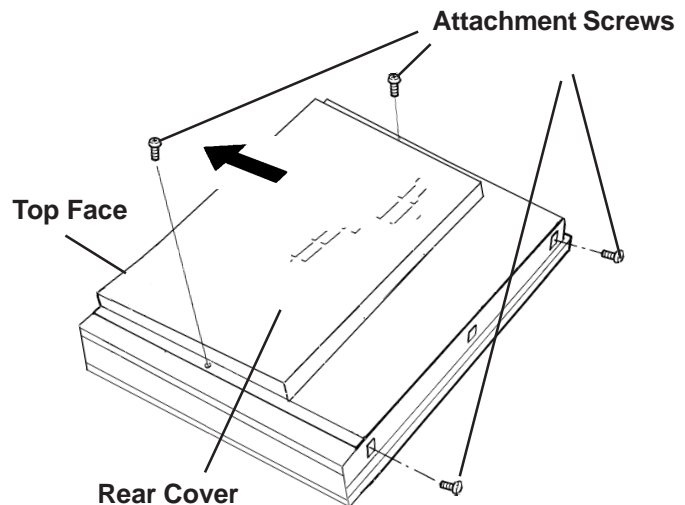


Chapter 3 - Optional Units

- 3) Remove the Rear Cover and expose the interior of the DU Front Panel (see Fig. A.)

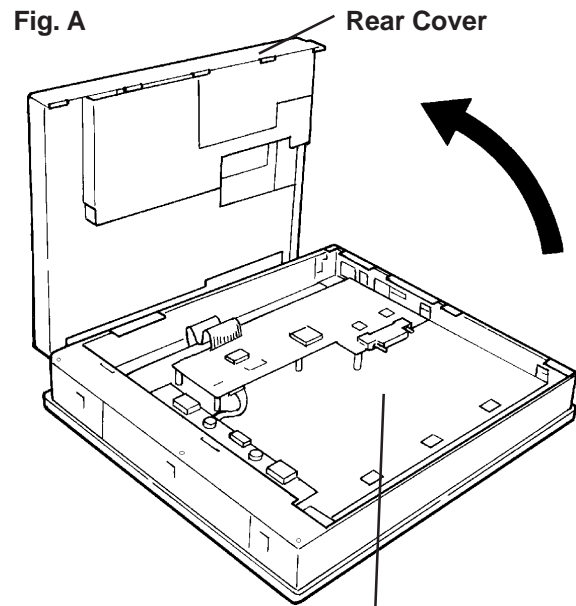


- 4) Loosen the Side Cover's screw, and push the Front Panel's Slide in the direction shown to release it. (See Fig. B.) Then, tighten the Side Cover's screw.

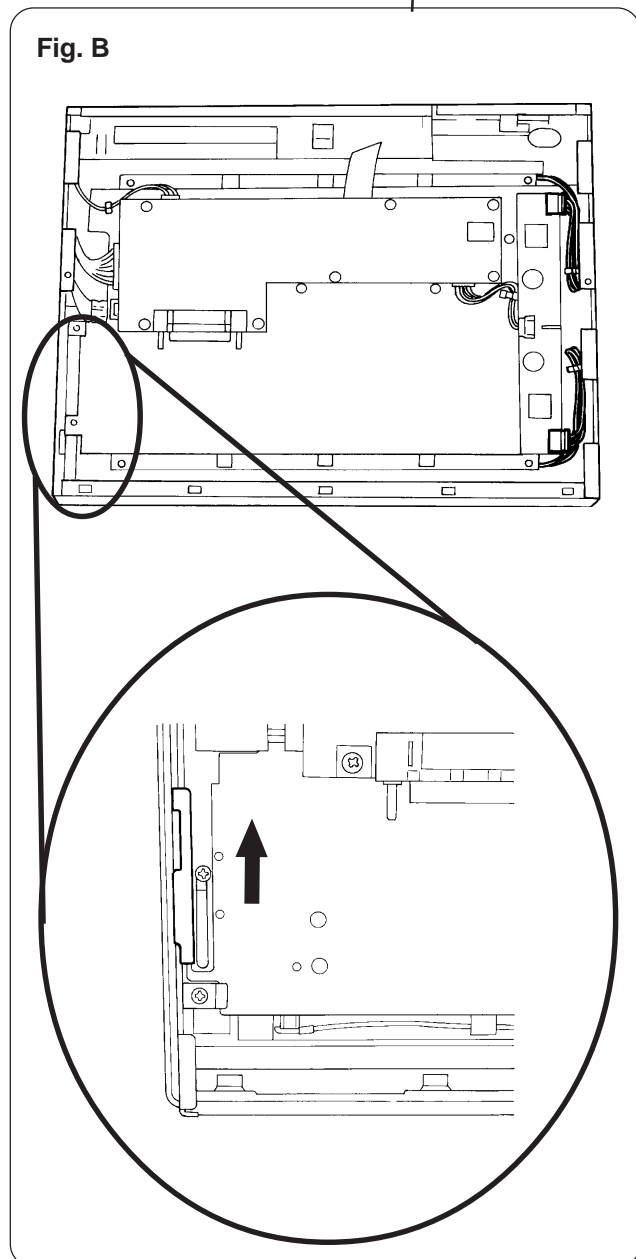

Chapter 3 - Optional Units

- 5) Unscrew the three (3) Cover A Attachment Screws and remove Cover A (see figure.)

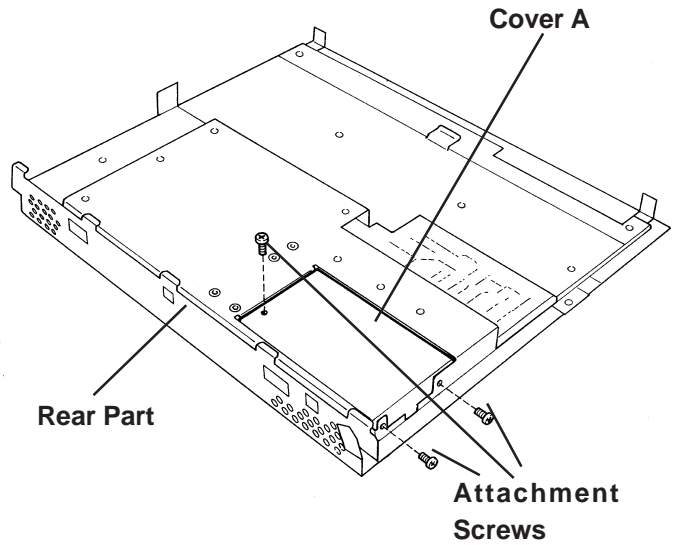


- 6) After inserting the PL-PE200, check that the PL and the PL-PE200 connectors are correctly aligned, insert the PL-PE200's three (3) attachment screws removed in step 5) and secure the unit in place.



- **Since the PL-PE200 contains precision parts, be sure to handle it carefully.**
- **Do not push or press on the PL-PE200 too strongly, since it may damage the unit.**

- 7) Reattach the Rear Cover to the Front Panel, using the four (4) attachment screws removed in step 3).

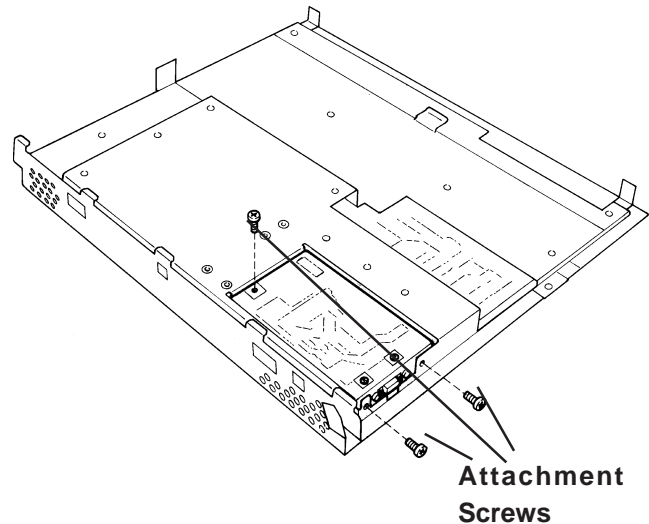


When installing the PL-PE200 in a PL-DU7900-T42, you need to also re-attach the Side Cover, using the two (2) attachment screws removed in step 2).


3.1.2 Installing the USB Front Access Unit (PL-US200)

Use the following procedure to install the PL-US200 in the DU.

- 1) Unscrew the blank panel's three (3) attachment screws and remove the DU rear face's PL-US200 blank panel.

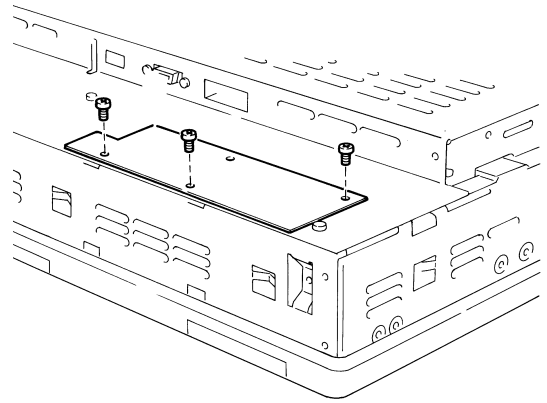


- 2) Unscrew the PL-US200 front blank panel's two (2) screws from inside the DU's rear face.

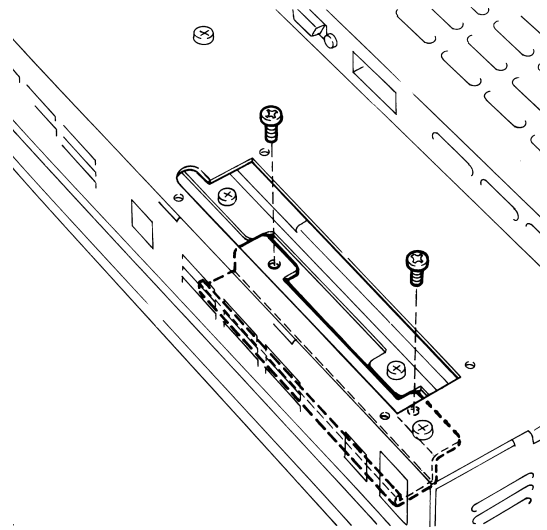


Chapter 3 - Optional Units

- 3) Insert the PL-US200 into the PL and secure it in place with two (2) attachment screws.

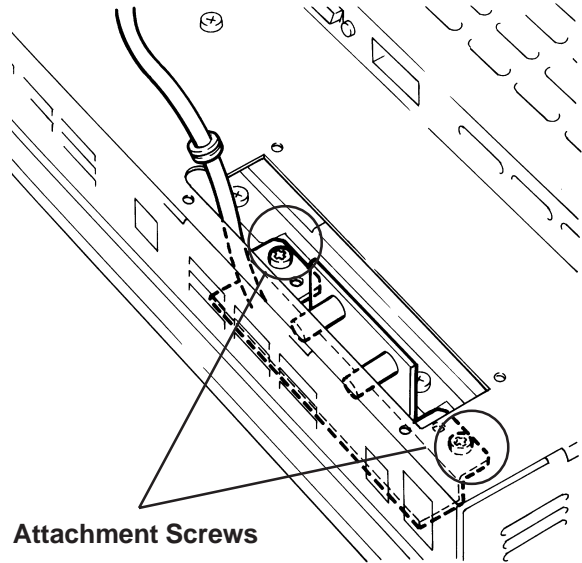

- 4) Insert the PL-US200's USB Connector into the DU's USB Socket.
- 5) Insert the PL-US200 cable's black Rubber Stopper in the DU rear panel's notch. Then, replace the PL-US200's rear blank panel, rotating it 180° from its original orientation, and secure it in place with its three (3) attachment screws.

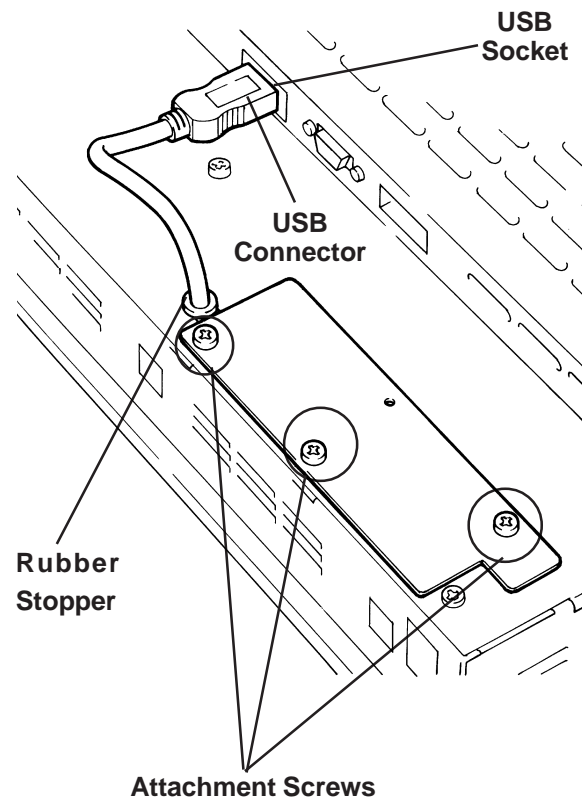

- **Do not pinch the PL-US200 cable against the DU's chassis or against other devices.**
- **Do not pull the PL-US200's cable too strongly.**


Chapter

4 Installation and Wiring

- 1. DU Installation Cautions
- 2. DU Installation
- 3. Wiring Cautions


4.1 DU Installation Cautions

4.1.1 Temperature Related Cautions

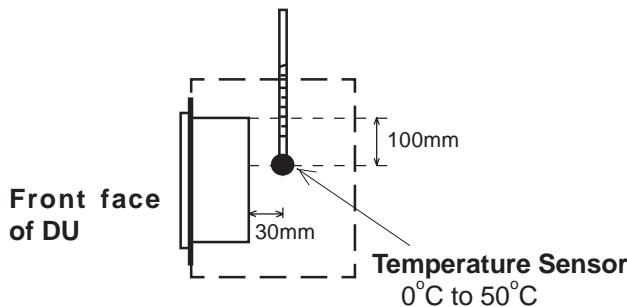


Be sure to confirm that the area near the DU will be within the allowable temperature range by placing a temperature sensor in the location shown in the left-side drawing. If this area's temperature exceeds the allowed limit, a machine breakdown can occur.

4.1.2 Installation Positioning Cautions

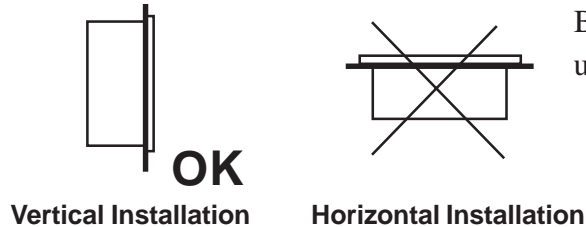


Be sure to install the panel in an upright (vertical) position.

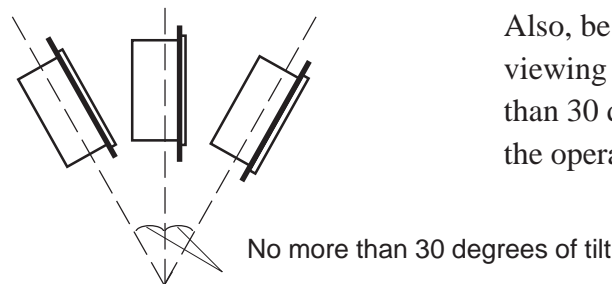

Also, be sure that the panel's viewing angle is tilted no more than 30 degrees from parallel to the operator (i.e. directly in front).

4.1.3 Shock / Vibration Related Cautions

Be sure to protect the DU from excessive vibration or jolting. These kinds of shocks can cause the DU to malfunction.

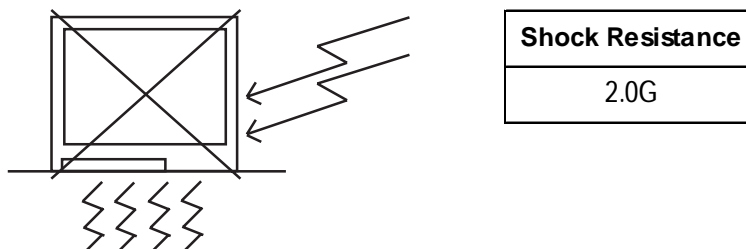

4.2 DU Installation


4.2.1 Installation

■ Confirm the Installation Gasket's Seating

It is strongly recommended that you use the gasket.

Place the DU on a level surface with the display panel facing downward. Check that the DU's installation gasket is seated securely into the gasket's groove, which runs around the perimeter of the panel's frame.

Reference For more information about installing the gasket, refer to *5.1.2 Installation Gasket Replacement*

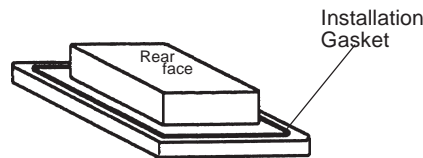


Be sure the gasket is in place before installing the DU.


■ Creating a Panel Cut Out

Create the correct sized opening required to install the DU, using the installation dimensions given. The moisture resistant gasket, installation fasteners and attachment screws are all required when installing the DU.

Reference *2.4 Display Unit Dimensions*




- Check that the installation panel or cabinet's surface is flat, in good condition and has no jagged edges.
- Panel thickness should be from 1.6mm to 10.0mm.
- Be sure to consider the weight of the DU when designing the panel.

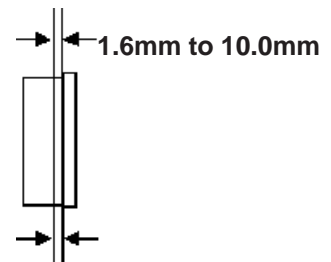


To enhance the DU's maintainability, operability and ventilation, allow at least 50mm clearance between the DU and any other objects. (The clearance must be large enough to allow you to insert or remove expansion boards and to attach connectors.)

Side View

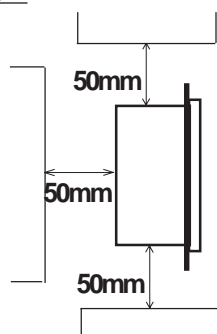


Rear View

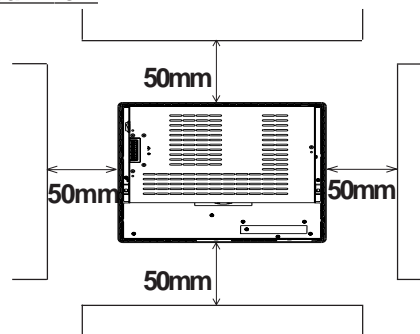

■ DU Viewing Angle




- The DU must be installed vertically. Also, the DU uses a cooling fan. To operate the DU correctly, be sure that the panel's viewing angle is tilted no more than 30 degrees from parallel to the operator (i.e. when the operator is directly in front).

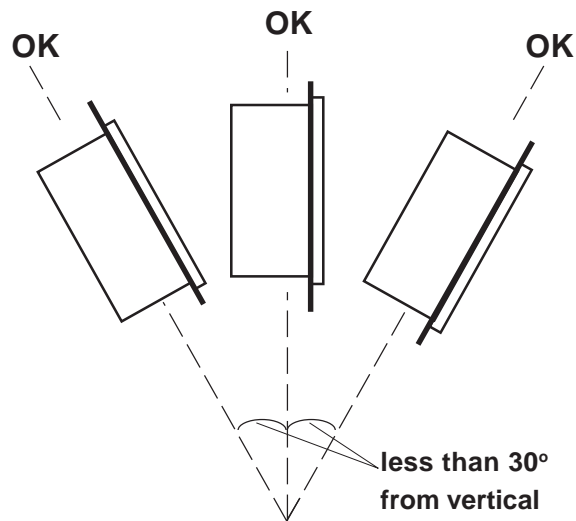

- Avoid placing the DU next to other devices that might cause overheating.
- Avoid using the DU where the ambient temperature will exceed 50°C.
- Keep the DU away from arc-generating devices such as magnetic switches and non-fuse breakers.
- Avoid using the DU in environments where corrosive gases are present.

■ Insert the DU into the Panel Cut Out

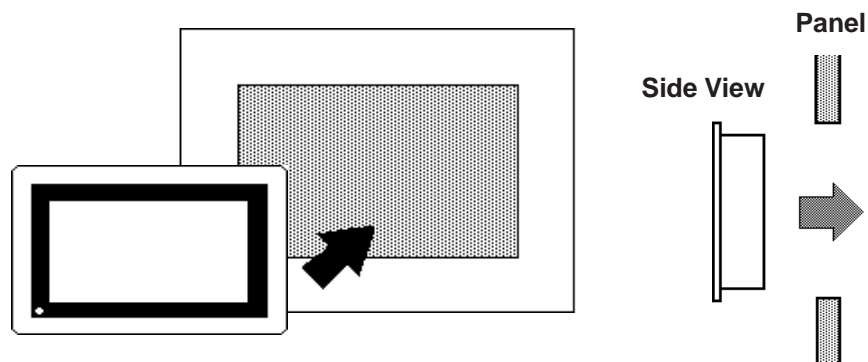


Be sure the installation panel's actual measurements are the same as those given in this chapter, otherwise the DU may slip or fall out of the panel.

Chapter 4 - Installation and Wiring



■ Securing the Installation Fasteners

- 1) There are eight (8) insertion slots on the top and bottom of the PL-DU6900, and twelve (12) insertion slots on the top and bottom of the PL-DU7900 where the metal installation fasteners hook on.

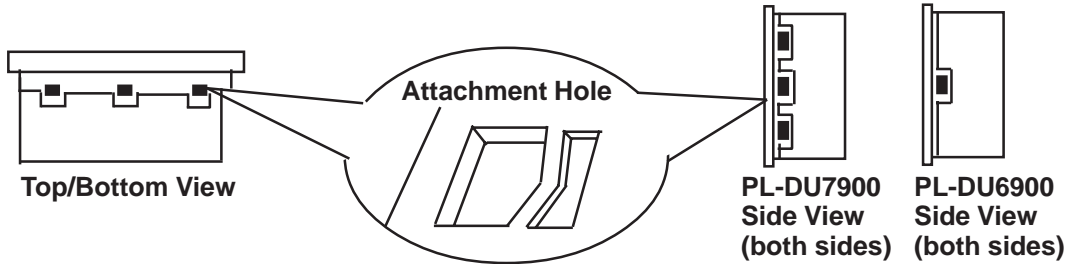


- 2) Insert each fastener into its attachment hole.


Installation Fastener

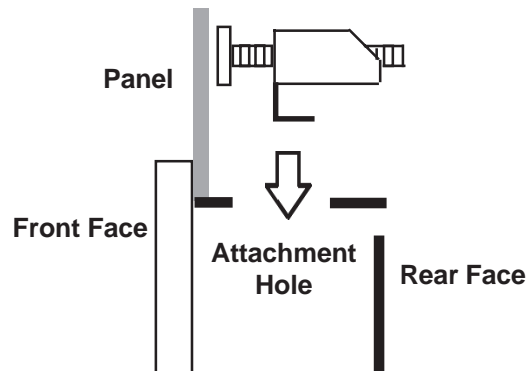

- 3) Slide the fastener backwards until it stops.

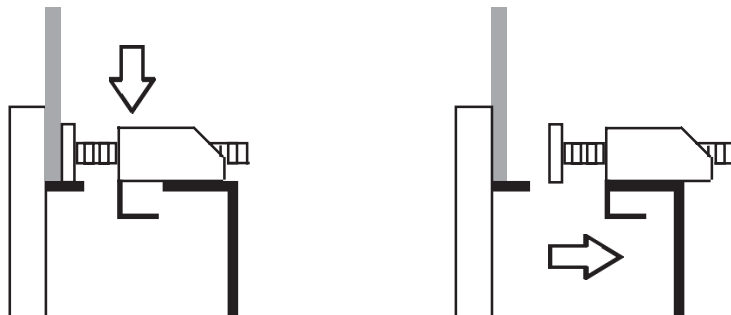

- 4) Use a screwdriver to tighten each bracket's adjustment screw. To ensure a high degree of moisture resistance, the torque should be 0.5 to 0.6 N•m.

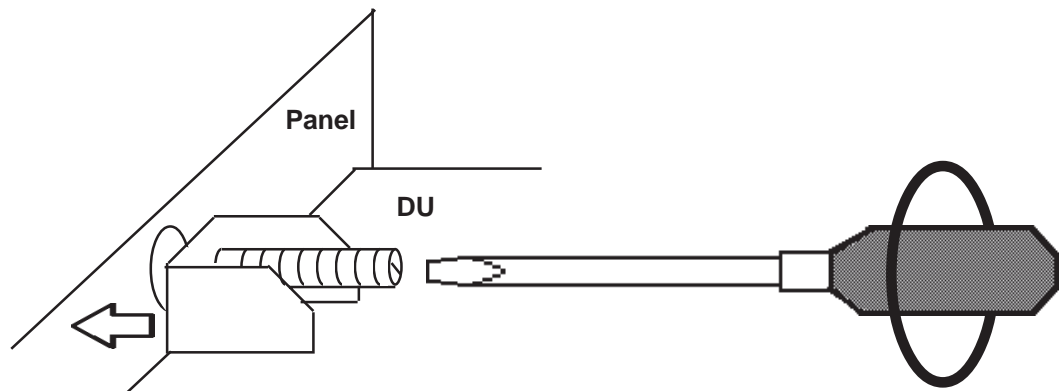

Excessive torque may damage the panel or bracket.


4.3 Wiring Cautions

4.3.1 Connecting to PL

After connecting the DU to the PL-B900 Series unit and setting up the PL's OS, you will need to complete the DU's screen settings and touch panel calibration.

For details, refer to **Reference** *BOX-Type Industrial Computer PL-B900/B910 Series Users Manual*.


4.3.2 Connecting the Power Cord

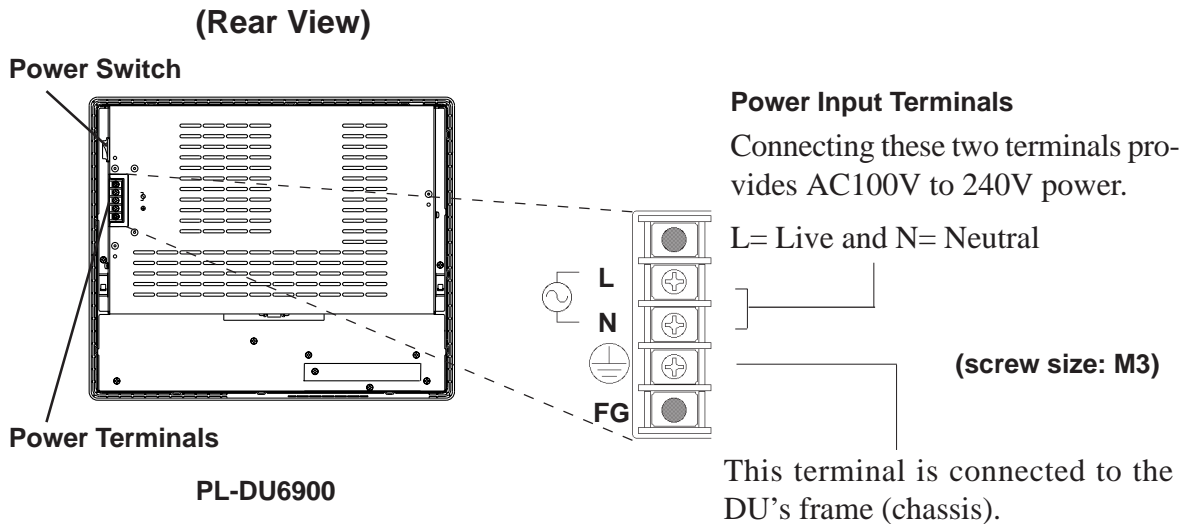


WARNINGS

- To prevent electric shocks, be sure to turn the DU OFF before connecting the power cord.
- To prevent fires, electrical hazards and equipment damage, be sure to use only the specified power supply voltage when operating the DU.

Use the following steps when connecting the power cord to the DU's power terminals.

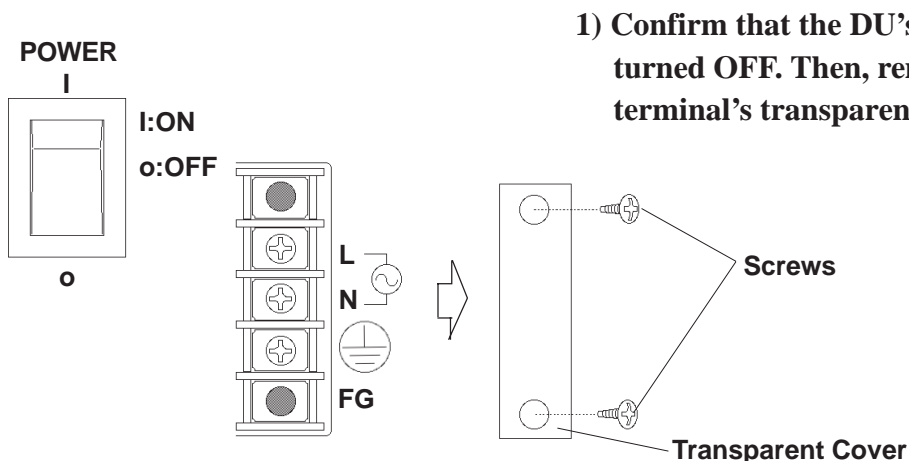


Chapter 4 - Installation and Wiring

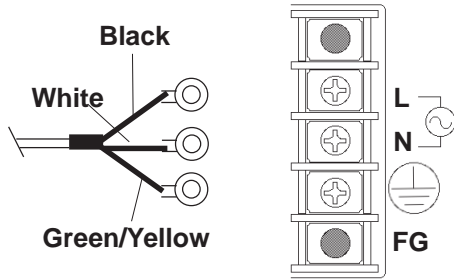


- 2) Loosen and remove the middle three screws from the terminal strip. Align the crimp terminals with each screw hole, and tighten the screws.



- Crimp Terminal Types : V1.25-3, by J.S.T. or equivalent (JIS standard part number : RAV1.25-3)
- Crimp terminals must be the same as shown below.

Max. 6.0 mm  ϕ 3.2 mm or larger

Attachment Screws

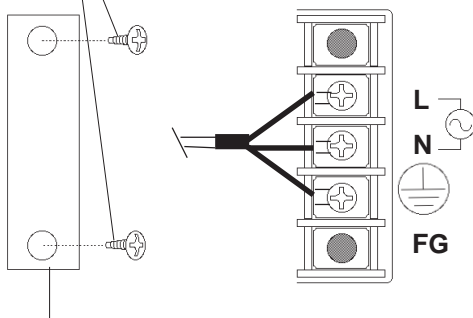

Transparent Cover








- *The colors used in the figure above are for the cord which came with the DU.*
- *This power cord is designed only for AC100V/AC115V use. Be sure to use a different cable when using other than AC100V/AC115V power.*

- 3) Reattach the terminal strip's transparent cover and secure it in place with its attachment screws.

4.3.3 Connecting the DU's Power Supply

Be sure to follow cautions explained here when connecting the power cord to the DU's Power Input Terminals.

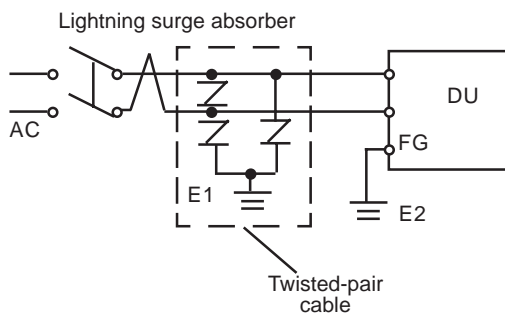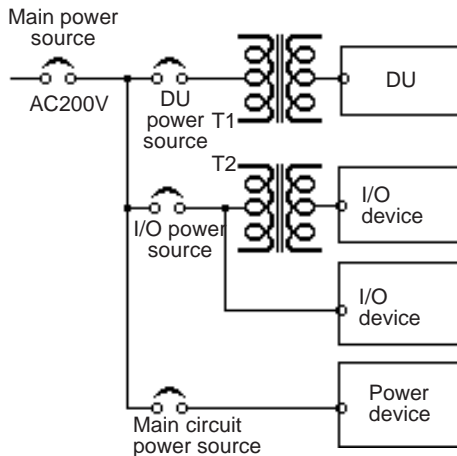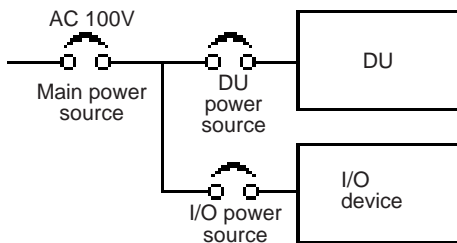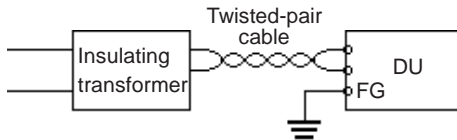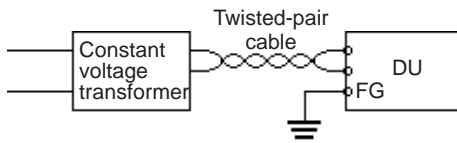

- If voltage fluctuations are expected to vary beyond the specified range, connect a constant voltage transformer.

Reference For information about the specified voltage, refer to **2.1 General Specifications.**

- Use a low-noise power supply both between the lines and between the DU and its ground. If there is still excess noise, connect an insulating transformer (noise-prevention type).



Be sure any constant or insulating transformer used has a capacity of important 70VA or more.

- Wire the power cords of the DU, I/O devices, and power supply devices separately.

- To improve noise immunity, it is recommended to attach a ferrite core to the power cord.
- Isolate the main circuit (high voltage, large current) line, I/O signal lines, and power cord, and do not bind or group them together.
- To prevent damage from lightning, connect a lightning surge absorber.



Ground the lightning surge absorber (E1) and the DU (E2) separately.

- **Select a lightning surge absorber which will not exceed the allowable circuit voltage, even when the voltage rises to the maximum.**

Chapter 4 - Installation and Wiring


4.3.4 Grounding the DU

(a) Dedicated Ground - best ^{*1}




- Set up a dedicated ground when using the rear panel's FG terminal.

(b) Shared Ground - allowed ^{*1}

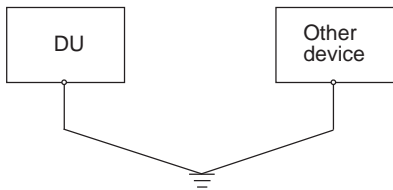

- If a dedicated ground is not possible, use a shared ground, as shown in figure (b).
- The grounding point must be as close to the DU as possible, and the grounding wires must be as short as possible. If the wires must be long, use thick, insulated wires and run them through conduits.

(c) Shared ground - not allowed

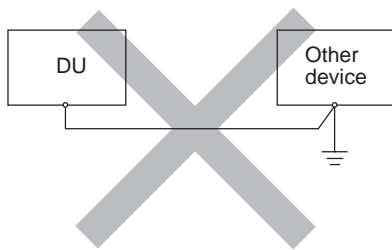

4.3.5 Cautions When Connecting I/O Signal Lines

- I/O signal lines must be wired separately from the power cord.
- If the power code needs to be wired together with the cord (I/O) signal lines for any reason, use shielded cables and ground one end of the shield to the DU's FG terminal.
- To improve noise immunity, attaching a ferrite core to the power cord is recommended.

**1 Use a grounding resistance of less than 100 Ω and a 2mm² or thicker wire, or your country's applicable standard. For details, contact your local DU distributor.*

Chapter

5 Maintenance

1. Regular Cleaning
2. Changing the Backlight
3. Periodic Check Points

5.1 Regular Cleaning

5.1.1 Cleaning the Display

When the surface or the frame of the display gets dirty, soak a soft cloth in water with a neutral detergent, wring the cloth tightly, and wipe the display.



- ***Do not use paint thinner, organic solvents, or a strong acid compound to clean the unit.***
- ***Do not use hard or pointed objects to operate the touch-screen panel, since it can damage the panel surface.***



Use the optional Screen Protection Sheet when using the DU in extremely dirty or dusty areas.

5.1.2 Installation Gasket Replacement

The installation gasket protects the DU and improves its water resistance. For instructions on installing the DU's gasket, **Reference** *Chapter 4 Installation and Wiring*.



A gasket which has been used for a long period of time may have scratches or dirt on it, and could have lost much of its water resistance. Be sure to change the gasket periodically (or when scratches or dirt become visible).

5.2 Changing the Backlight

The DU's backlight can be replaced after it has burned out. To replace the backlight, follow the steps shown below.



Note:

Please use the following table to identify which backlight model number to use when ordering your backlight.

DU unit	Backlight Type
PL-DU6900	GP675T-BL00-MS
PL-DU7900	PL7900T-BL00-MS




If the backlight or the display unit are damaged, the screen display will go out. Even if the screen goes out, however, there is a possibility that the touch panel is still operating correctly. Therefore, since any type of touch panel contact could have an unexpected or dangerous result, be sure not to touch the screen when this condition occurs.

WARNINGS


- Whenever changing the backlight, be sure the DU's power cord has been disconnected.
- When the DU's power has just been turned OFF, the backlight area is still very hot! Be sure to wear gloves to prevent being burned.
- When the DU's power cord is connected and the DU is ON, high voltage runs through the wires in the backlight area—*do not touch them!*
- Do not try to replace the backlight while the DU is installed in a cabinet or panel. Remove the DU first, then begin the backlight replacement procedures.
- Do not touch the glass tube. If the glass tube is broken you may be injured.

Follow the steps shown below to replace the DU's backlight. Be sure to wear cotton gloves while replacing the backlight to prevent burns.

- 1) Unplug the DU's power cord from the main power supply. If you do not, it may cause an electric shock.
- 2) Disconnect the DU power cord terminals from the DU's power terminal block.



Remove Power Terminals


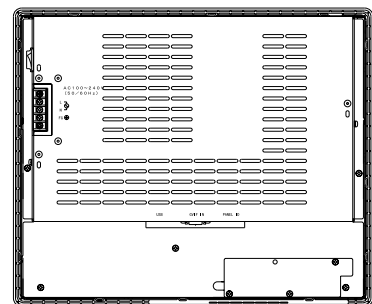


PL-DU7900




- **Be sure to replace the backlight on a flat, level surface. This will prevent damage to the DU unit and the accidental cutting of any of its power cord terminals.**
- **The PL-DU7900 has a cover. When replacing the PL-DU7900's backlight, you need to unscrew this cover's two (2) attachment screws and remove it.**

- 3) Remove the DU's four chassis attachment screws.
- 4) Hold both sides of the DU's front panel section and use your thumbs to slide (push) the chassis forward in the direction shown here (see figure).
- 5) The chassis can then be pivoted back and open. Remove the three (3) attachment screws from inside the Front Unit.

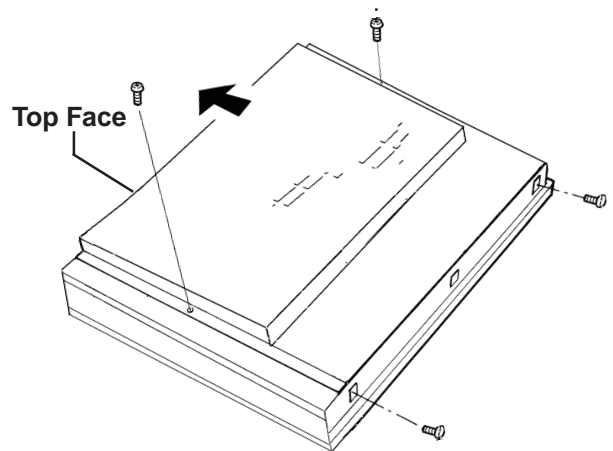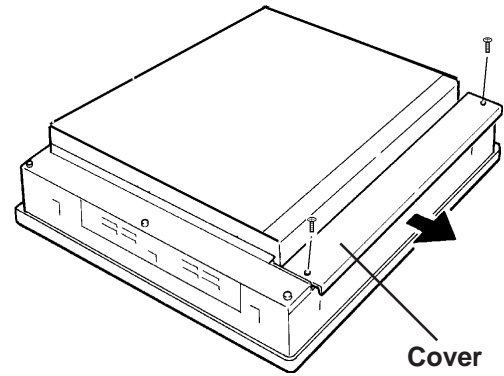

When changing the PL-B6900 backlight, use steps 6) to 13) on the Page 5-4 to 5-6.


When changing the PL-B7900 backlight, use steps 6) to 14) on the page 5-7 to 5-8.

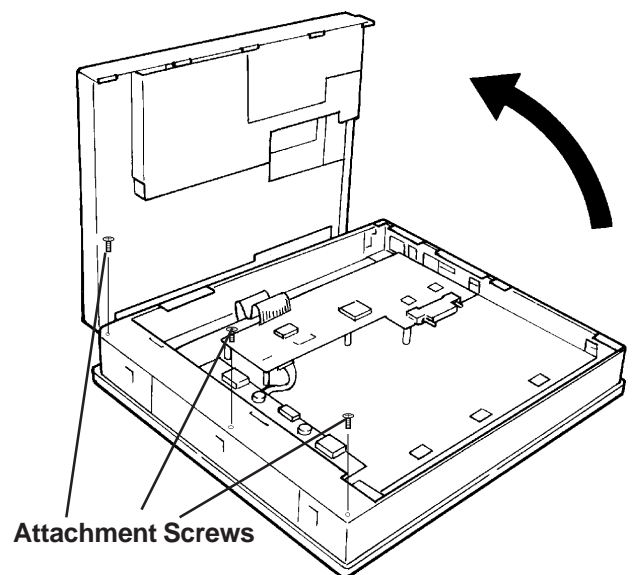


Chapter 5 - Maintenance

■ When Changing the PL-DU6900 Backlight


- 6) Disconnect both backlight power connectors from the board.

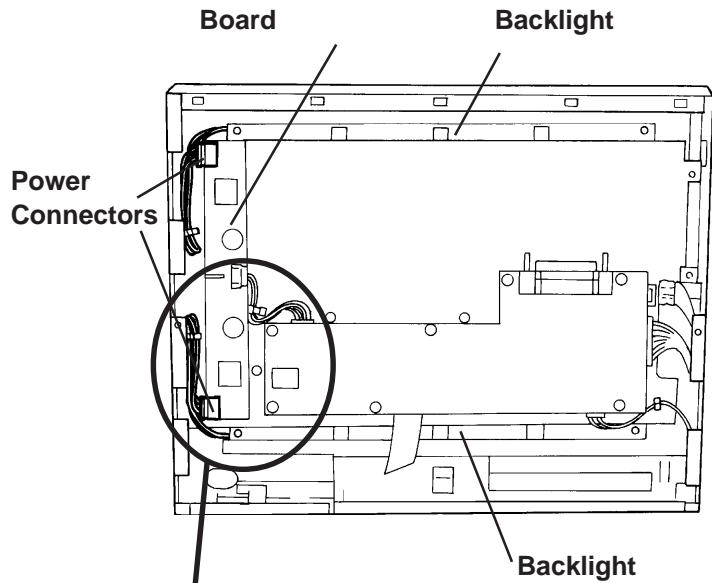

- 7) Each backlight (upper and lower) is fixed in place with two (2) attachment screws. Remove these 4 screws.

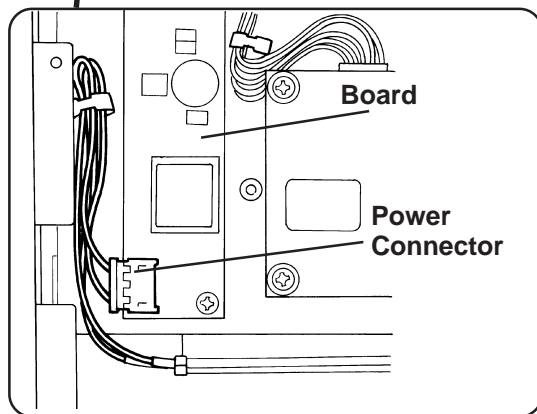



- **Use an "0" sized Phillips screwdriver to remove the backlight attachment screws.**
- **Be careful not to lose any of the small attachment screws.**
- **Do not let any of attachment screws fall inside the DU unit's chassis or front panel area, since it could cause an electrical short when the DU's power is turned ON again.**

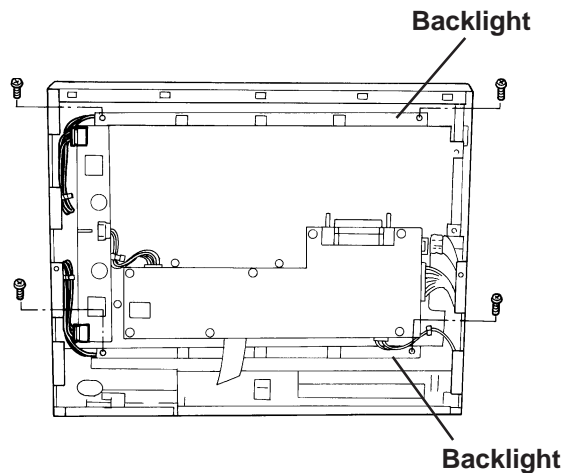

- 8) Open/release each plastic cable holder.




Note: Each backlight uses a cable holder to prevent the cable from becoming caught or pinched when the DU's rear cover is opened or closed. Be sure both cables are secured by their holder before closing the rear cover.

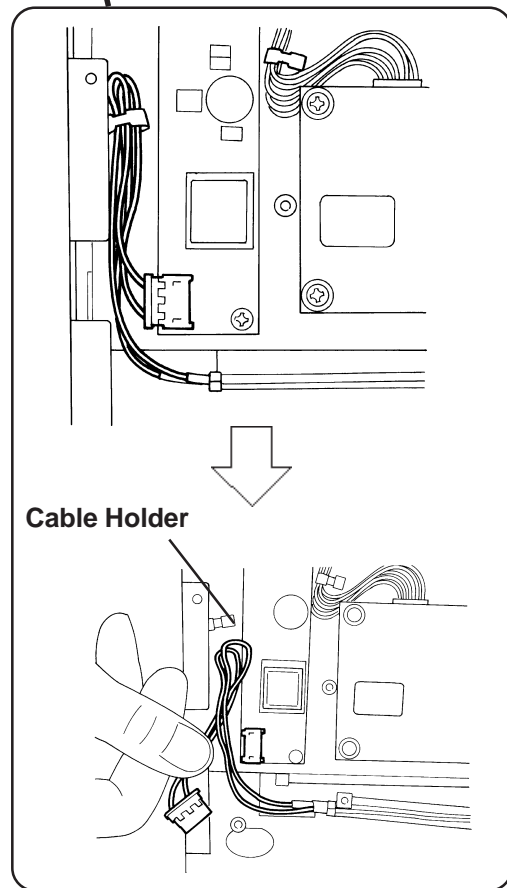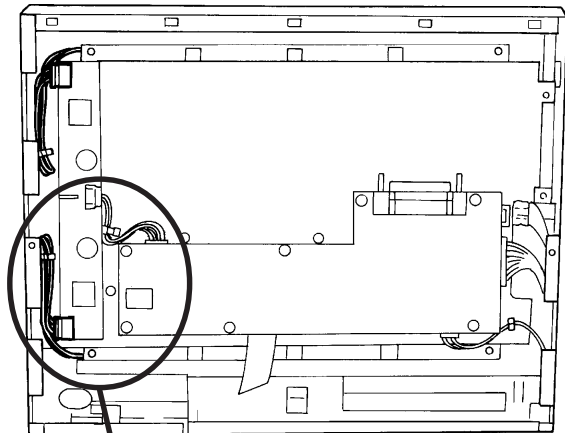


Chapter 5 - Maintenance

- 9) Remove each backlight unit.
- 10) Insert each new backlight. Be sure to hold the new backlights with the metal clips.
- 11) After installing both new backlights using steps 9) to 10), replace and tighten all attachment screws (total of 4 screws). Then, reconnect both board power connectors.

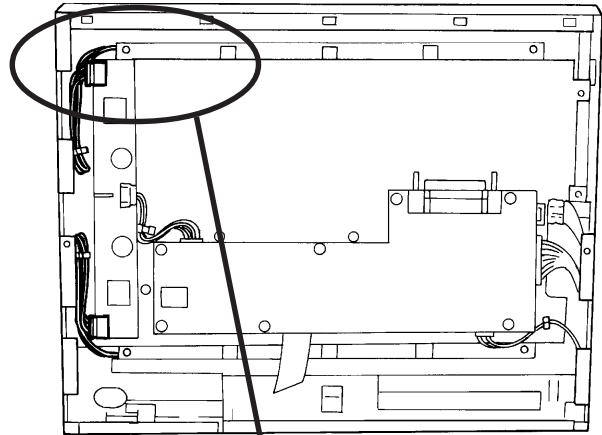


- ***Be sure to always change both DU backlights at the same time.***
- ***Be sure that the backlight's power cord connector is inserted completely into the board's receptacle. If not, the DU may be damaged.***

- 12) Reattach the rear cover, being careful not to pinch any internal electrical wires.
- 13) Replace and tighten the DU Rear face's four chassis attachment screws.

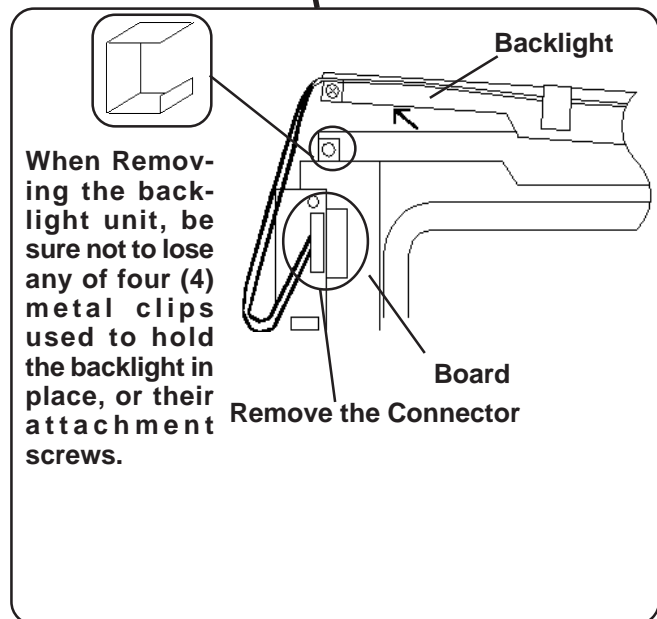


■ When Changing the PL-B7900 Backlight

6) The DU's LCD display unit is fixed in place with two (2) attachment screws. Remove these screws.

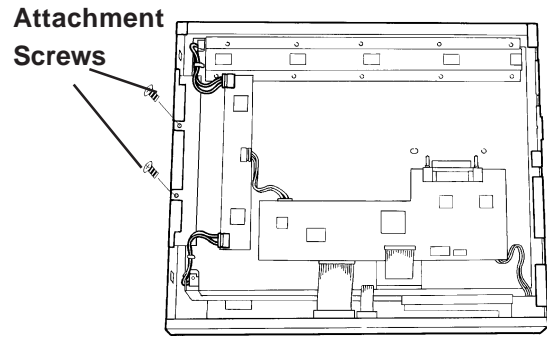

7) Disconnect both backlight power connectors from the Inverter Board.

8) Each backlight (upper and lower) is fixed in place with an attachment screw. Remove each of these screws.

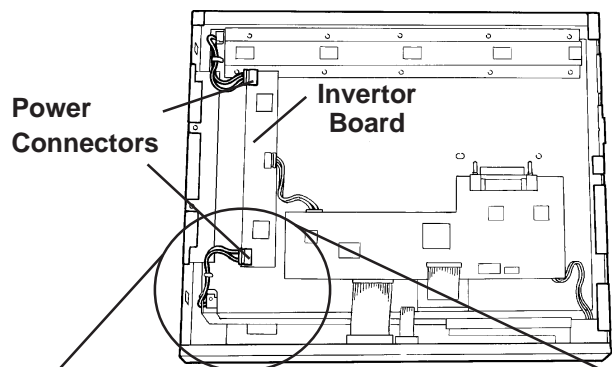


• Use a "1" sized Phillips screwdriver to remove the backlight attachment screws.

• Be careful not to lose any of the small attachment screws.

• Do not let any of attachment screws fall inside the DU unit's chassis or front panel area, since it could cause an electrical short when the DU's power is turned ON again.


9) Open/release each plastic cable holder.

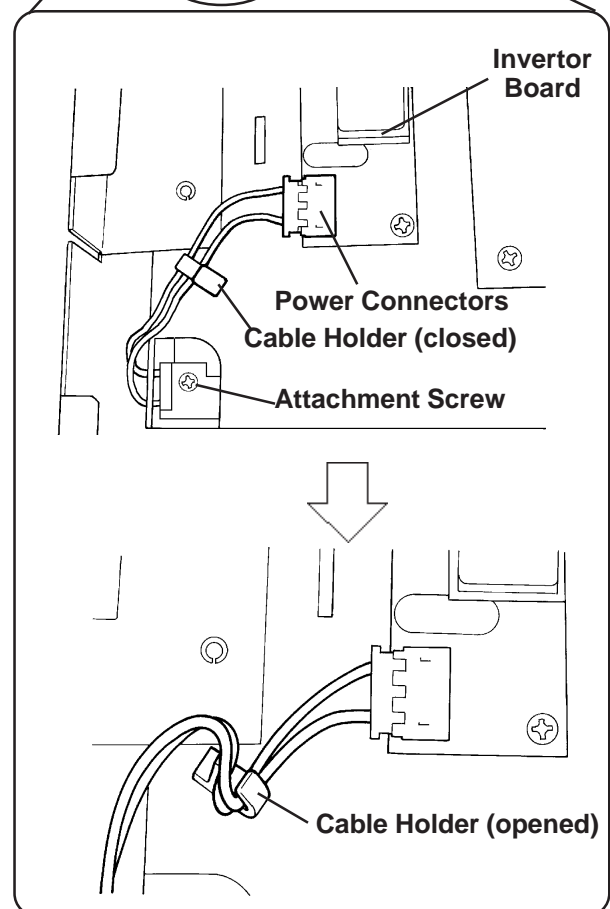

Each backlight uses a cable holder to prevent the cable from becoming caught or pinched when the DU's rear cover is opened or closed. Be sure both cables are secured by their holder before closing the rear cover.

Chapter 5 - Maintenance

- 10) Remove each backlight unit.
- 11) Insert each new backlight.
- 12) After installing both new backlights using steps 9) to 11), replace and tighten all backlight and LCD panel attachment screws (total of 4 screws). Then, re-connect both board power connectors.

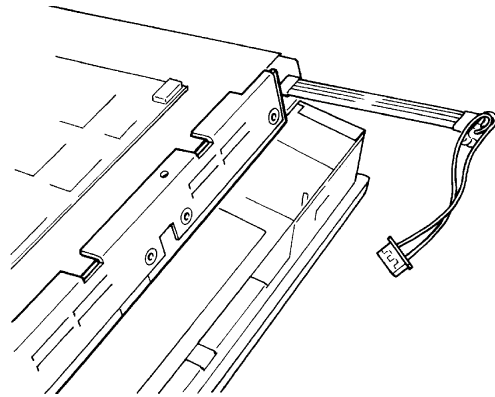

- ***Be sure to always change both DU backlights at the same time.***
- ***Be sure that the backlight's power cord connector is inserted completely into the board's receptacle. If not, the DU may be damaged.***

- 13) Reattach the rear cover, being careful not to pinch any internal electrical wires.
- 14) Replace and tighten the DU's four chassis attachment screws.

5.3 Periodic Check Points

To keep your DU unit in good working condition, please check the following points periodically.

DU Operation Environment

- Is the operating temperature within the allowable range?
- Is the operating humidity within the specified range (30% RH to 85% RH)?
- Is the operating atmosphere free of any corrosive gasses?

Electrical Specifications

- Is the input voltage appropriate (AC85V to AC265V 50/60Hz) ?

Related Items

- Are all cables connected properly? Have any become loose?
- Are all mounting brackets holding the unit securely?
- Are there many scratches or traces of dirt on the moisture resistant gasket?

Display Check

- Is the display bright enough ?



Note: When the DU's backlight needs to be replaced, please contact your local DU distributor.

Memo

Index

A

- About PL-DU*900 Models 8
- Accessories 1-5

B

- backlight type 5-2
- Brightness Adjustment Slide 2-4

C

- CE Marking Notes 11
- Changing the Backlight 5-2
- Cleaning the Display 5-1
- Connecting I/O Signal Lines 4-8
- Connecting the DU's Power Supply 4-7
- Connecting the Power Cord 4-5
- Connecting to PL 4-5
- Crimp Terminal Types 4-6

D

- Display Area 2-4
- Display Specifications 2-3
- Display Unit Dimensions 2-5
- Documentation Conventions 8

E

- electric hazards 3-1
- Electrical Specifications 2-1
- Environmental Specifications 2-1
- Essential Safety Precautions 2

F

- Front Maintenance Cover 2-4
- Full Sized Cover Attachment Dimensions 1-2, 1-3
- Functional Specifications 2-3

G

- General Safety Precautions 5
- General Specifications 2-1
- Grounding 4-8

H

- Hardware Reset Switch 2-4

I

- Icon Meaning 2
- Insert the DU into the Installation Slot 4-3
- Installation 3-1
- Installation and Wiring 4-1
- Installation Cautions 4-1
- Installation Gasket 4-2
- Installation Gasket Replacement 4-2, 5-1
- Installation Positioning Cautions 4-1
- Introduction 1-1
- IrDA 2-4

K

- Keyboard Connector 2-4

L

- LCD Handling Caution 4
- LCD Usage and Handling 5

M

- Maintenance 5-1
- Maintenance Options 1-2, 1-3
- Moisture Resistant Gasket 4-2
- Moisture Resistant Gasket Replacement 4-2, 5-1
- moisture resistant seal 4-2

N

- Names and Functions 2-4

P

- Package Contents 10
- Panel Installation Opening 4-2
- panel thickness 2-6, 4-2
- PL-DU7900 Installation Fasteners 2-6
- Performance Specifications 2-3
- Periodic Check Points 5-9
- PL Connector 2-4
- PL Installation 3-1
- PL-DU*900 Features 9
- PL-DU*900 Installation 4-2
- PL-DU6900 External Dimensions 2-5
- PL-DU6900 Installation Fasteners 2-6
- PL-DU7900 External Dimensions 2-5
- PL-DU7900 Installation Fasteners 2-6

Index

Power Input Terminals	4-5
Power Switch	2-4
Power Terminals	2-4
Preface	1
Prior to Using the DU	5

R

Regular Cleaning	5-1
------------------------	-----

S

Securing the Installation Fasteners	4-4
Shock / Vibration Related Cautions	4-1
Specifications	2-1
Status LED	2-4
Structural Specifications	2-2
System Design	1-1

T

Table of Contents	6
Temperature Related Cautions	3-5, 4-1
Touch Panel	2-4

U

UL/c-UL(CSA) Application Notes	11
--------------------------------------	----

V

Viewing Angle	4-3
---------------------	-----

W

Wiring Cautions	4-5
-----------------------	-----